

Linear Performance Indices to Predict Oscillatory Stability Problems in Power Systems

Claudio A. Cañizares, *Senior Member, IEEE*, N. Mithulananthan, *Student Member, IEEE*, Federico Milano, *Student Member, IEEE*, and John Reeve, *Fellow, IEEE*

Abstract—Various indices are proposed and studied to detect and predict oscillatory instabilities associated with Hopf bifurcations in power systems. A methodology is also presented to produce a linear profile for these indices. They are based on eigenvalue and singular values of the state and extended system matrices. Their application to several test power systems are presented to demonstrate their usefulness, particularly for on-line applications.

Index Terms—Hopf bifurcations, on-line performance indices, second order index, eigenvalues, singular values, subsynchronous resonance, power system oscillations.

I. INTRODUCTION

NONLINEAR phenomena, including bifurcations and chaos, occurring in power system models have been the subject of several studies during the last two decades (e.g. [1], [2], [3], [4], [5], [6], [7]). Among the different types of bifurcations, saddle-node, limit-induced, and Hopf bifurcations (HBs) have been identified as pertinent to instability problems in power systems [8], [7].

In the case of saddle-node bifurcations, a singularity of a system Jacobian and/or state matrix results in disappearance of steady state solutions, whereas in the case of certain types of limit-induced bifurcations, the lack of steady state solutions arises from system controls reaching limits (e.g. generator reactive power limits). Both bifurcation modes typically lead to voltage collapse [9]. HBs, on the other hand, produce limit cycles (periodic orbits) that may lead the system to oscillatory instabilities, as it has been shown in a variety of power system models (e.g. [2], [8], [10], [11]), and observed in practice (e.g. [12], [13]).

HBs could arise due to variable net damping, frequency dependence of electrical torque and voltage control issues (e.g. fast acting automatic voltage regulators in generators) [10], [14], and are typically triggered by system contingencies. In most cases, these bifurcations occur on very stressed systems, i.e. heavily loaded systems. This is a concern nowadays, as many current networks operate near their stability limits due to economical and environmental constraints. Incidents of

Hopf bifurcation (HB) induced system collapses include the Sri Lankan power system disturbance of May 2, 1995 [12], and the Western System Coordination Council (WSCC) system disturbance of August 10, 1996 [13]. With ways of predicting and controlling HBs, the above incidents conceivably could have been avoided by operator action (e.g. load shedding). Further planning studies can then be pursued to place PSS and/or proper FACTS controllers to take care of the oscillation problems in a more permanent basis [15].

The attention of researchers reported in the literature has been more in trying to reveal the presence of HBs, rather than on their prediction. An index to determine the proximity of a system to a HB with respect to a given system parameter would be beneficial, especially as a tool in system operation. While there has been some work done in this area using optimization techniques [16], extensive computations and optimizations are needed every time the topology of the system changes. Methods to detect HBs in general dynamical systems based on using the real part of a “critical” eigenvalue as an index are presented in [17]; however, its non-linear behavior in some cases makes it impractical for power system applications, as shown in the present paper. A closed-loop monitoring system for detecting impending instability related to HBs in uncertain nonlinear plants is proposed in [18]; an advantage of this methodology is that it gives a warning at a point close to the instability even when no accurate system model is available. However, earlier prediction of such an event is not possible, as the index is not continuous or smooth. A predictable index with a quasi-linear profile is useful in projecting problematic loading levels, for a given generation and load directions, both in planning and operation stages. By predicting a problem (e.g. HB) well in advance, a measure can be devised (e.g. load shedding) to mitigate the problem. In the current paper, linear profile indices are proposed and their practical benefits are demonstrated.

This paper is organized as follows: Section II explains briefly the basic theory behind HBs from the point of view of power systems. The proposed indices are discussed in Section III together with a methodology to linearize them. In Section IV, the results obtained for various test systems are presented and discussed, from the point of view of on-line application of the proposed indices. Finally, the main contributions made in this paper are highlighted in Section V.

II. HOPF BIFURCATIONS

Power system oscillations problem are classically associated with a pair of complex eigenvalues of system equilibria

Submitted to *IEEE Trans. Power Systems*, May 2002; accepted June 2003.

The research work presented here was developed under the financial support of NSERC, Canada, and the E&CE Department at the University of Waterloo.

C. A. Cañizares and J. Reeve are with the Department of E&CE, University of Waterloo, Waterloo, ON, Canada, N2L-3G1, c.canizares@ece.uwaterloo.ca.

N. Mithulananthan is with the Asian Institute of Technology, Bangkok, Thailand, mithulan@thunderbox.uwaterloo.ca

F. Milano is with the Dept. of Electrical Engineering, University of Genoa, Genoa, 16145, Italy, fmilano@epsl.die.unige.it, and is currently a Visiting Scholar at the E&CE Department, University of Waterloo.

(operating points) crossing the imaginary axis of the complex plane, from the left half-plane to the right half-plane, when the system undergoes sudden changes (e.g. line outages) [19]. If this particular oscillatory problem is studied using more gradual changes in the system, such as changes on slow varying parameters like system loading, it can be directly viewed as a HB problem [6], [10]. Thus, by predicting or detecting these types of bifurcations well in advance to the onset of a possible oscillatory instability, this type of problem can be avoided.

HBs are characterized by periodic orbits or limit cycles emerging around an equilibrium point. These types of bifurcation are also known as oscillatory bifurcations. In order to explain the basic theory behind the HB from the point of view of power system, consider the following DAE model of a power system:

$$\begin{aligned} \dot{x} &= f(x, y, \lambda, p) \\ 0 &= g(x, y, \lambda, p) \end{aligned} \quad (1)$$

where $x \in \mathfrak{R}^n$ is a vector of state variables, such as generator internal angles and rotational speed; $y \in \mathfrak{R}^m$ is a vector of algebraic variables, such as load voltage magnitudes; $\lambda \in \mathfrak{R}^\ell$ is a set of uncontrollable parameters, such as active and reactive power load variations; and p is a set of controllable parameters, such as AVR set points. When the parameters λ and/or p vary, the equilibrium points (x_o, y_o) change, and so do the eigenvalues of the corresponding system state matrix. The equilibrium points are asymptotically stable if all the eigenvalues of the system state matrix have negative real parts. The point where a complex conjugate pair of eigenvalues reach the imaginary axis with respect to the changes in (λ, p) , say $(x_o, y_o, \lambda_o, p_o)$, is known as a HB point.

At a HB point $(x_o, y_o, \lambda_o, p_o)$, the following conditions are satisfied [17]:

- 1) $[f(x_o, y_o, \lambda_o, p_o) \ g(x_o, y_o, \lambda_o, p_o)]^T = 0$.
- 2) The Jacobian matrix evaluated at $(x_o, y_o, \lambda_o, p_o)$ should only have a simple pair of purely imaginary eigenvalues $\mu = \pm j\beta$.
- 3) The rate of change of the real part of the critical eigenvalues with respect to a varying system parameter, say λ_i , should be nonzero.

If this is the case, there is a limit cycle at $(x_o, y_o, \lambda_o, p_o)$ with a period $T_o = 2\pi/\beta$.

These conditions imply that a HB corresponds to a system equilibrium state with a pair of purely imaginary eigenvalues with all other eigenvalues having non-zero real parts, and that the pair of bifurcating or critical eigenvalues cross the imaginary axis as the parameters (λ, p) change, yielding oscillations in the system.

III. HOPF BIFURCATION INDICES

A. Eigenvalue Index (EVI)

In [17], the real part of the complex pair of eigenvalues crossing the imaginary axis (critical eigenvalues) is used as an index to predict the HB point. Hence, in this paper, the

behavior of the following index is studied in power system applications:

$$EVI = |\alpha| \quad (2)$$

where α is the real part of the critical eigenvalue μ .

B. First Index (HBI_1)

Since at a HB point the system Jacobian has a simple pair of purely imaginary eigenvalues, the problem can be restated as follows: For the system state matrix A , a complex pair of eigenvalues can be rewritten as

$$A [v_R \pm jv_I] = [\alpha \pm j\beta] [v_R \pm jv_I] \quad (3)$$

where $A = D_x f|_0 - D_y f|_0 D_y g|_0^{-1} D_x g|_0$; α and β are the real and imaginary parts of the critical eigenvalue μ , respectively; and $v_R \pm jv_I$ is the associated eigenvector. If real and imaginary parts are separated from equation (3), it follows that

$$\begin{aligned} (A - \alpha I_n)v_R + \beta v_I &= 0 \\ (A - \alpha I_n)v_I - \beta v_R &= 0 \end{aligned}$$

$$\Rightarrow \left(\underbrace{\begin{bmatrix} A & +\beta I_n \\ -\beta I_n & A \end{bmatrix}}_{A_m} - \alpha I_{2n} \right) \begin{bmatrix} v_R \\ v_I \end{bmatrix} = 0 \quad (4)$$

Since $[v_R \ v_I]^T \neq 0$, at a HB where $\alpha = 0$, the modified matrix A_m becomes singular. Observe that this matrix is also singular at a saddle-node bifurcation, as $\alpha = \beta = 0$ in this case.

Following the same criteria previously proposed to define indices for saddle-node bifurcations [9], the singular value of the modified state matrix is used here as an index for detecting HBs. Thus, the first Hopf bifurcation index (HBI) is defined as follows:

$$HBI_1(A, \beta) = \sigma_{min}(A_m) \quad (5)$$

where σ_{min} is the minimum singular value of the modified state matrix A_m , which becomes zero at a Hopf or saddle-node bifurcation point.

C. Second Index (HBI_2)

The HBI_1 index has the problem that it requires the computation of the state matrix A , which is computationally expensive, as it requires the inverse of the jacobian $D_y g|_0$. This problem can be avoided if the full system matrix is used. Thus, using a generalized eigenvalue formulation, for a complex pair of eigenvalues, it follows that

$$\begin{bmatrix} J_1 & J_2 \\ J_3 & J_4 \end{bmatrix} \begin{bmatrix} v_{1R} \pm jv_{1I} \\ v_{2R} \pm jv_{2I} \end{bmatrix} = [\alpha \pm j\beta] \begin{bmatrix} v_{1R} \pm jv_{1I} \\ 0 \end{bmatrix} \quad (6)$$

where $J_1 = D_x f|_0$, $J_2 = D_y f|_0$, $J_3 = D_x g|_0$, and $J_4 = D_y g|_0$. By separating the real and imaginary parts and

rearranging these equations:

$$\left(\begin{array}{c} \left[\begin{array}{cccc} J_1 & J_2 & \beta I_n & 0 \\ J_3 & J_4 & 0 & 0 \\ -\beta I_n & 0 & J_1 & J_2 \\ 0 & 0 & J_3 & J_4 \end{array} \right] \\ \underbrace{\hspace{10em}}_{J_m} \\ -\alpha \left[\begin{array}{cccc} I_n & 0 & 0 & 0 \\ 0 & 0 & 0 & 0 \\ 0 & 0 & I_n & 0 \\ 0 & 0 & 0 & 0 \end{array} \right] \end{array} \right) \begin{bmatrix} v_{1R} \\ v_{2R} \\ v_{1I} \\ v_{2I} \end{bmatrix} = 0 \quad (7)$$

Since $\alpha = 0$ at a HB, the matrix J_m becomes singular; notice that this also holds at a saddle-node bifurcation point. Therefore, the minimum singular value of the modified full Jacobian matrix J_m can be used as another index to indicate proximity to a Hopf or a saddle-node bifurcation. Thus,

$$HBI_2(A, \beta) = \sigma_{\min}(J_m) \quad (8)$$

This index is computationally more efficient than HBI_1 , as full advantage can be taken of the sparsity of J_m .

Observe that both indices HBI_1 and HBI_2 behave similarly to the singular value index of A and J , respectively, when the critical eigenvalue is real (the critical eigenvalue is defined here as the eigenvalue closest to the imaginary axis as the system parameter changes). Thus, for $\beta=0$:

$$A_m = \begin{bmatrix} A & 0 \\ 0 & A \end{bmatrix} \Rightarrow HBI_1 = \sigma_{\min}(A_m) = \sigma_{\min}(A) \quad (9)$$

and

$$J_m = \begin{bmatrix} J_1 & J_2 & 0 & 0 \\ J_3 & J_4 & 0 & 0 \\ 0 & 0 & J_1 & J_2 \\ 0 & 0 & J_3 & J_4 \end{bmatrix} = \begin{bmatrix} J & 0 \\ 0 & J \end{bmatrix} \Rightarrow HBI_2 = \sigma_{\min}(J_m) = \sigma_{\min}(J) \quad (10)$$

D. Linearization

Indices based on first order information such as critical eigenvalues and minimum singular values may be inadequate to predict possible instability problems in practical power systems, due to large discontinuities in the presence of system control limits (e.g. generator limits). However, this problem can be reduced by considering a ‘‘second order’’ index, i.e. an index defined by the index divided by its gradient with respect to the parameter under study, which exploits additional information embedded in these indices, as suggested in [20]. Thus, it has been observed that the critical eigenvalue and minimum singular value of a power system Jacobian can be approximated using the following equation [9]:

$$\gamma = (a - b\lambda)^{1/c} \quad (11)$$

where γ stands for the critical eigenvalue μ or minimum singular value σ_{\min} , with suitable values of the scalar positive constants a , b and c , and λ being a given varying parameter.

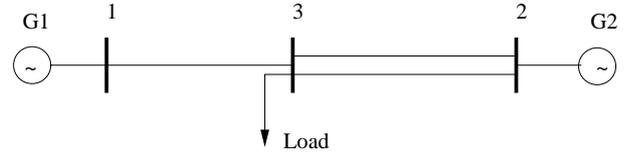


Fig. 1. Three-bus test system.

These type of functions can be made linear by dividing the function by its gradient at each point [9], since

$$\frac{\gamma}{d\gamma/d\lambda} = c\lambda - \frac{ac}{b} \quad (12)$$

Hence, by following the same idea, a linearized version for each of the EVI , HBI_1 and HBI_2 indices is proposed here:

$$LEVI = \frac{EVI}{|dEVI/d\lambda|} \quad (13)$$

$$LHBI_1 = \frac{HBI_1}{|dHBI_1/d\lambda|} \quad (14)$$

$$LHBI_2 = \frac{HBI_2}{|dHBI_2/d\lambda|} \quad (15)$$

It is worth mentioning that these indices can be applied to any nonlinear dynamical system to predict and detect HBs. However, the application to power systems is the primary concern of this paper.

IV. SIMULATION RESULTS

The Hopf bifurcation indices EVI , HBI_1 and HBI_2 , as well as $LEVI$, $LHBI_1$ and $LHBI_2$, were applied to several power system examples. Although most of the examples presented in this section are related to low frequency oscillations, an example of oscillatory problem associated with subsynchronous resonance phenomena is also presented and discussed.

A. Low Frequency Oscillations

In all the examples discussed in this section, loads were modeled as constant impedance models for stability studies, since these are the less onerous loads for the system (if HB problems are observed with these types of load models, similar problems could be reasonably expected with more stressful loads such as constant power load models). Furthermore, most of the commercial power system analytical tools use this as a default load model for dynamic analyses. For the associated power flow studies, all the loads were represented as typical constant real and reactive power models, and these are assumed to change according to

$$\begin{aligned} P_L &= P_{Lo}(1 + \lambda) \\ Q_L &= Q_{Lo}(1 + \lambda) \end{aligned} \quad (16)$$

where P_{Lo} and Q_{Lo} are the initial or base real and reactive power levels, respectively, and λ is the varying parameter representing the loading factor.

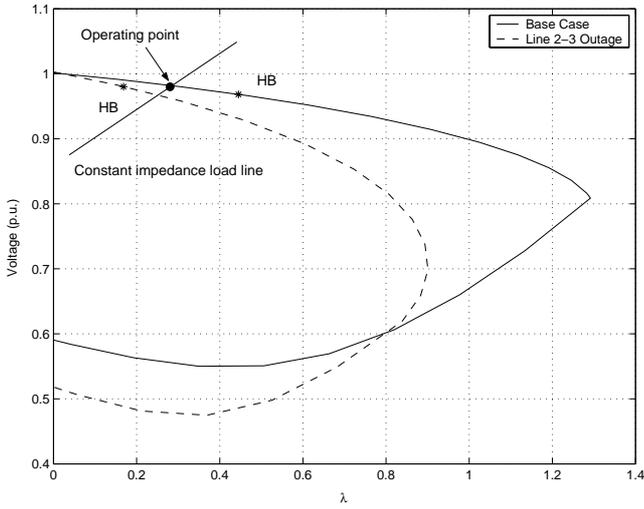


Fig. 2. P-V curves at bus 3 for the three-bus system.

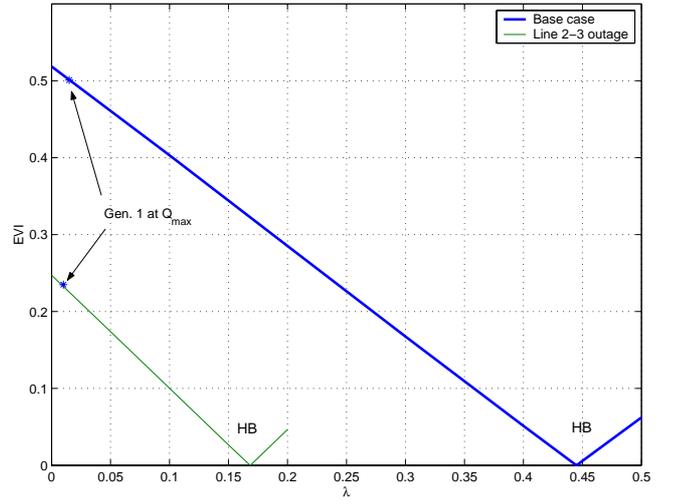


Fig. 4. Eigenvalue index for the three-bus system.

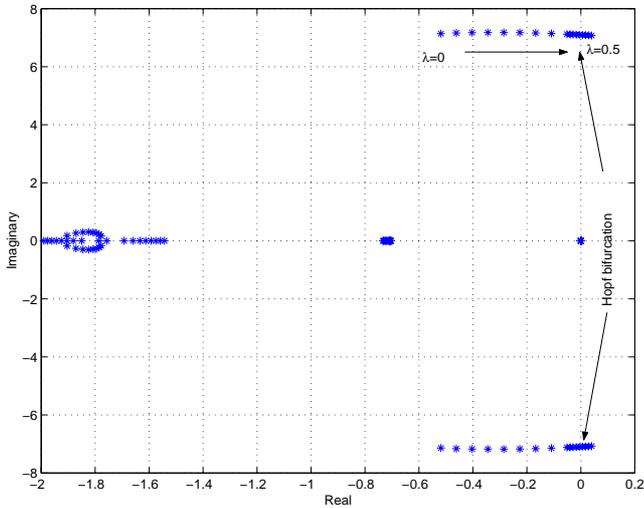


Fig. 3. Locus of the critical eigenvalue for the three-bus system base case.

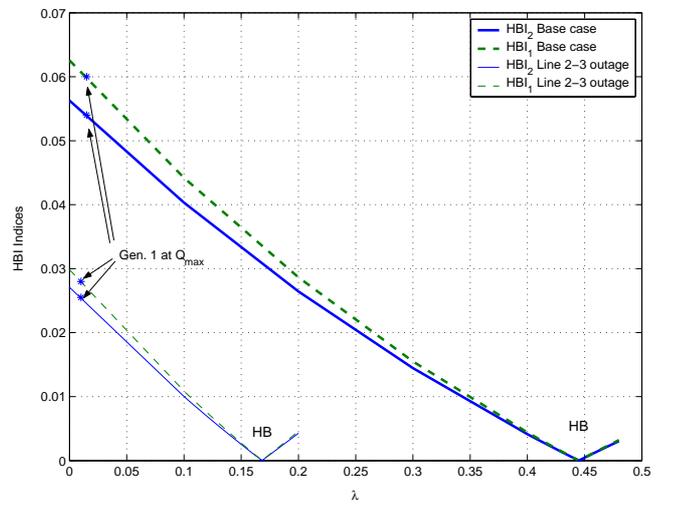


Fig. 5. Hopf bifurcation indices for the three-bus system.

1) *Three-bus System:* A one line diagram of the simplest test system used in this paper is shown in Fig. 1 [21]. Both generators were modeled in detail with standard exciters type AC4a [21], and hydraulic governors. The nominal load is 900 MW, and 300 Mvar.

Figure 2 shows the corresponding P-V curves at bus 3, for the base case and also for a line 2-3 outage. The real and reactive power required by the system are shared equally by both generators, as the system load increases up to the nose point. The HB points are also depicted in this figure, as well as the load line associated with an impedance load model; the crossing points of this line with the corresponding P-V curves define an equilibrium point of the associated dynamic system model.

Figures 3 shows the locus of the critical eigenvalue for the base case. As it can be seen in this figure, only the critical eigenvalue moves to the right as the loading parameter λ changes, and crosses the imaginary axis creating a HB condition; the rest of the eigenvalues do not change signif-

icantly with changes in λ (the zero eigenvalue is due to the absence of an infinite bus in the eigenvalue computations). A participation factor analysis indicates that the dominant state variables associated with the critical mode (HB modes) are the δ and ω of G2.

Figures 4, 5, 6 and 7 depict the Hopf bifurcation indices EVI , HBI_1 and HBI_2 , and their linearized versions $LEVI$, $LHBI_1$ and $LHBI_2$, respectively. In all these figures, the points at which generators reach reactive power limits are clearly highlighted. The second order or gradient information of the Hopf bifurcation indices required for the computation of $LEVI$, $LHBI_1$ and $LHBI_2$ are calculated numerically. All these indices, especially the linearized ones, show linear profiles with respect to the loading factor λ . According to the indices, loading the base system beyond 0.45 p.u. is problematic, showing also that a line 2-3 outage could lead the system to an oscillatory unstable condition when the system operates beyond a 0.163 p.u. loading factor level. All these results were confirmed through time domain simulations.

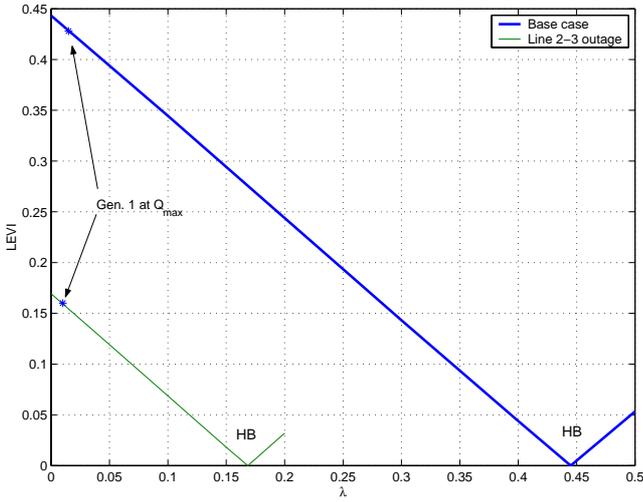


Fig. 6. Linearized eigenvalue index for the three-bus system.

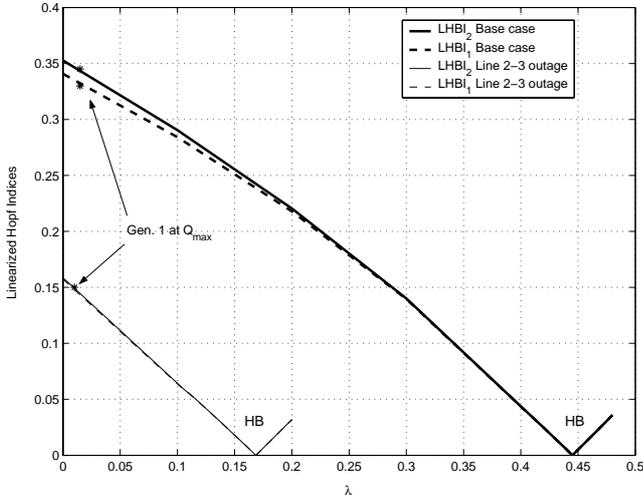


Fig. 7. Linearized Hopf bifurcation indices for the three-bus system.

2) *Two-area System*: Figure 8 is the one-line diagram of the “classical” two-area system proposed in [19] for oscillation studies. The topology of the system is symmetrical with respect to bus 8; however, the loads and the limits of individual generator are not equal in both areas. All of the generators were modeled in detail with a simple exciter, except for G2 which is modeled without a voltage control loop. A simple turbine governor is also considered in each of the generators, except for G3 which is modeled without a governor. The total system load is 2734 MW and 200 Mvar.

Figures 9, 10 and 11 show the corresponding P-V curves, and eigenvalue and HB indices, for the base case and for a line 9-10 outage, and Figs. 12 and 13 shows the linearized version of the eigenvalue and HB indices, respectively; no generator reactive power limits are reached in this case. Once again, the gradient information, which is necessary for obtaining of the linearized Hopf bifurcation indices, was calculated numerically. Observe the linear behavior of the indices. According to the results, loading the system beyond 0.081 p.u. is not feasible. A participation factor analysis indicates that the

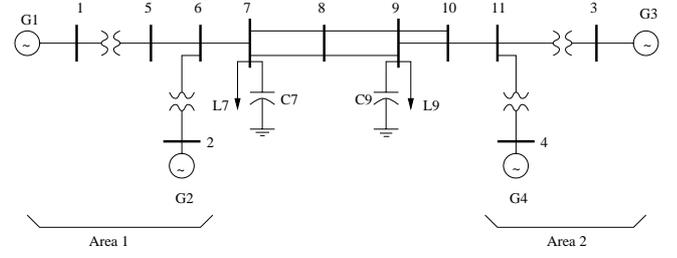


Fig. 8. Two-area test system.

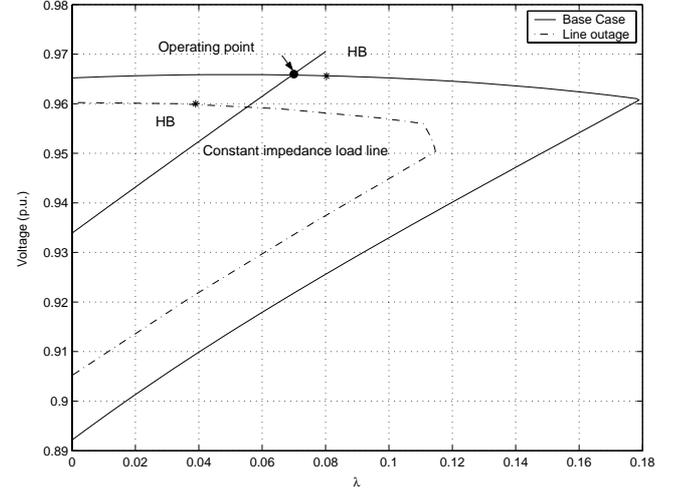


Fig. 9. P-V curves at bus 11 for the two-area system.

dominant state variables associated with the critical mode (HB mode) are δ and ω for G3. These results were verified using the time domain analyses.

3) *IEEE 50-machine System*: The IEEE 50-machine system shown in Fig. 14 is an approximated model of an actual power system, and was originally developed for stability studies [22]. It consists of 145 buses and 453 lines, including 52 fixed tap transformers. There are 60 loads for a total of 2.83 GW and 0.80 Gvar.

- 1) *Case I*: Seven of the generators are modeled in detail in this case, including complete models of their exciters. P-V curves including HB points for the base case and for a line 79-90 outage are shown in Fig. 15. The HB indices and the linearized version of the indices are given in Figs. 16, 17, 18 and 19, respectively; some of the points at which generators reach reactive limits are also highlighted in all these graphs. The line 79-90 outage was chosen since this line is one of the most heavily loaded lines in the weakest area of the system. Once again, observe the linear or quasi-linear profile of these indices with respect to the loading factor λ . In this case too, the gradient information of the HB indices with respect to the parameter was calculated numerically. All of the HB points were confirmed by time domain simulations.
- 2) *Case II*: In this case, six generators are modeled in detail with simple exciter models. Figures 20, 21, 22 and 23 depict the *EVI*, *HBI*₁ and corresponding *LEVI* and

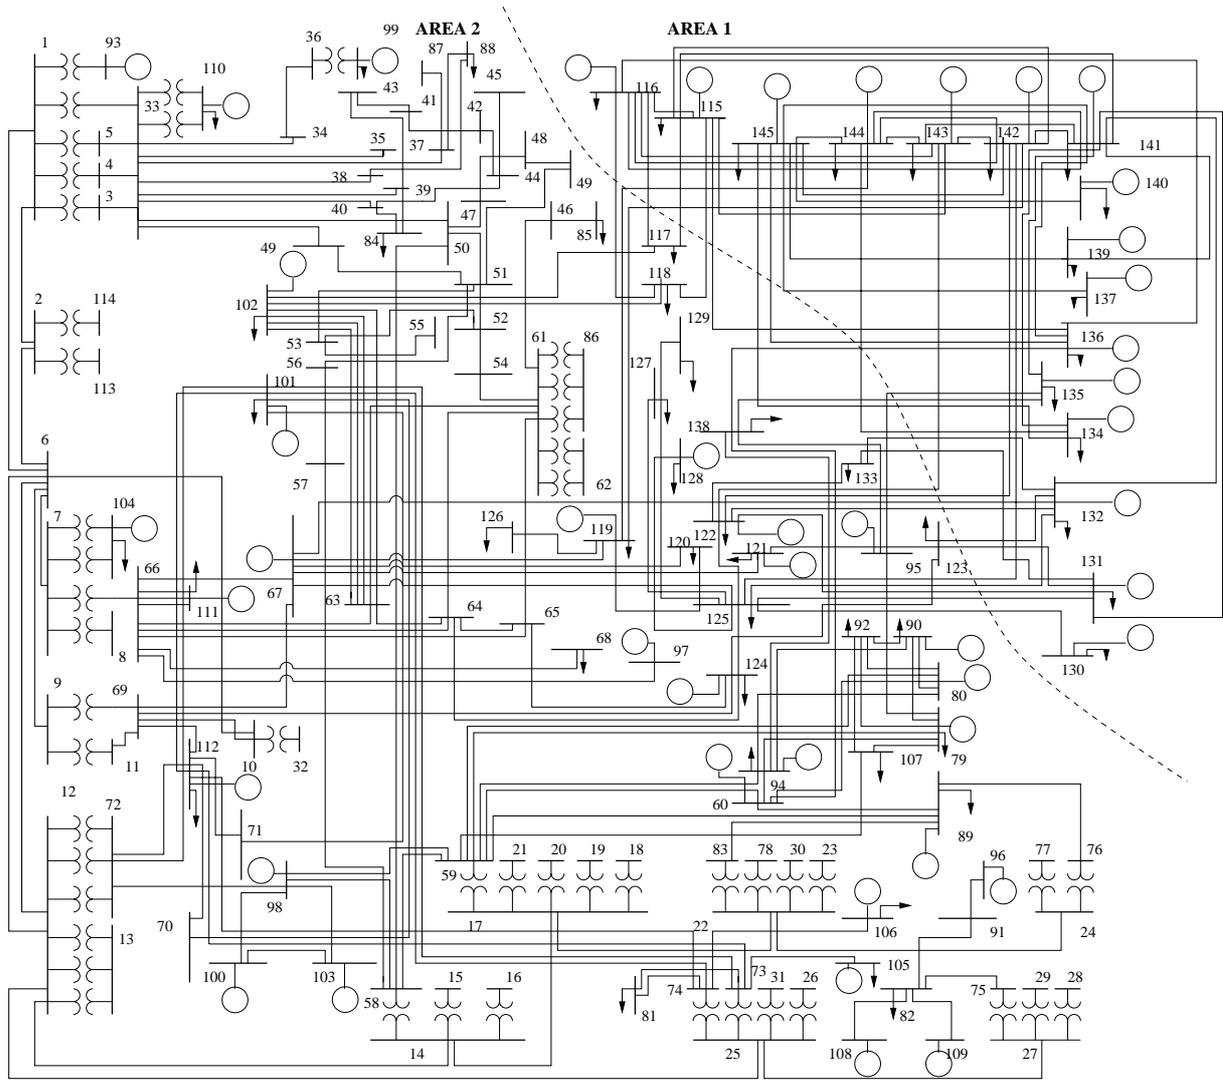


Fig. 14. IEEE 50-machine test system.

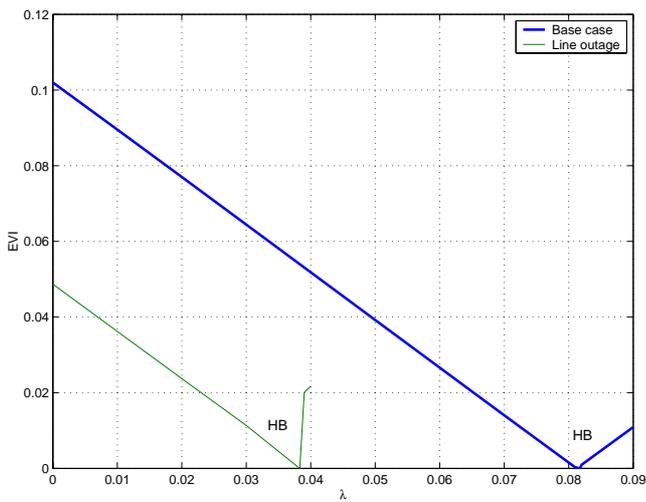


Fig. 10. Eigenvalue index for the two-area system.

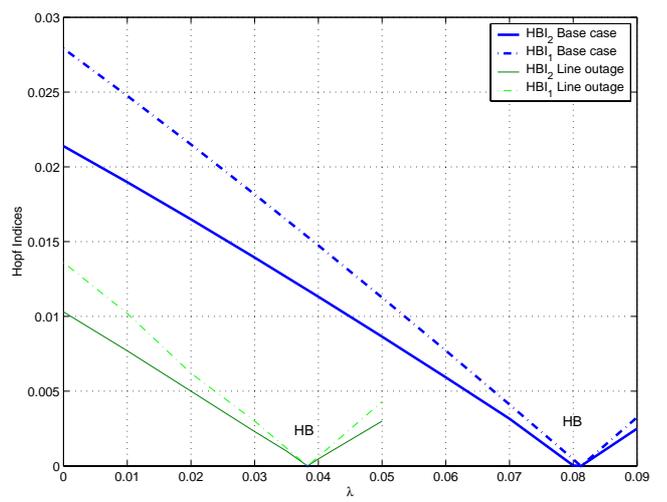


Fig. 11. Hopf bifurcation indices for the two-area system.

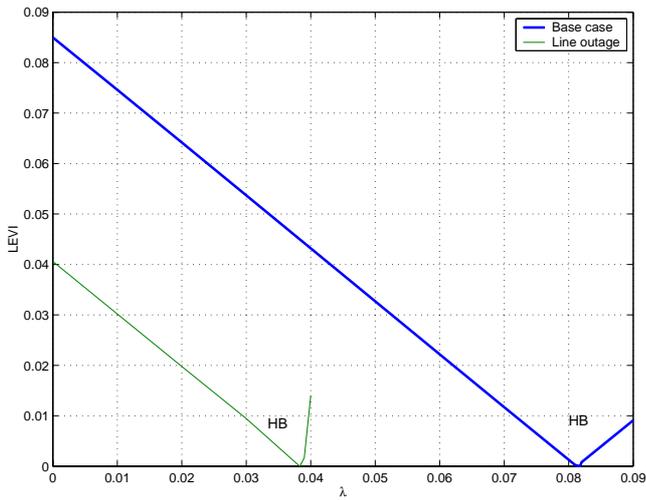


Fig. 12. Linearized eigenvalue index for the two-area system.

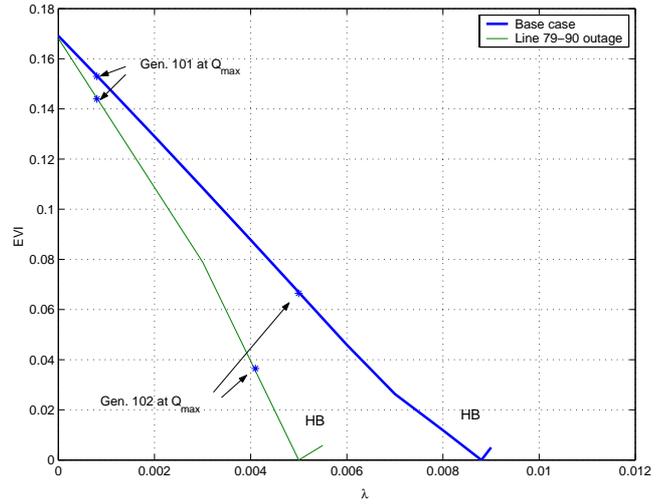


Fig. 16. Eigenvalue index for the IEEE 50-machine system, Case I.

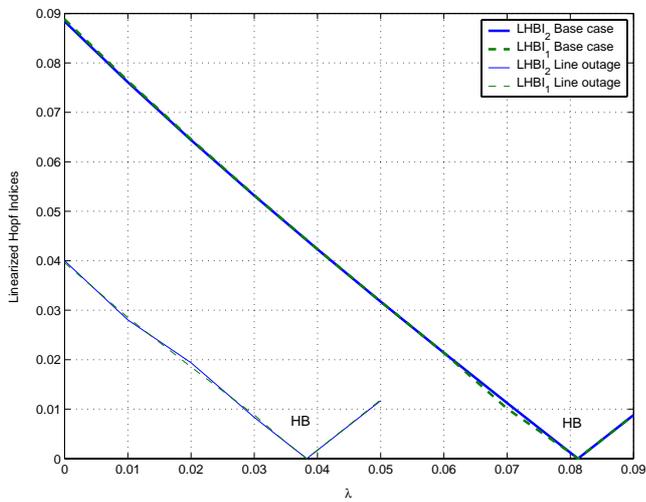


Fig. 13. Linearized Hopf bifurcation indices for the two-area system.

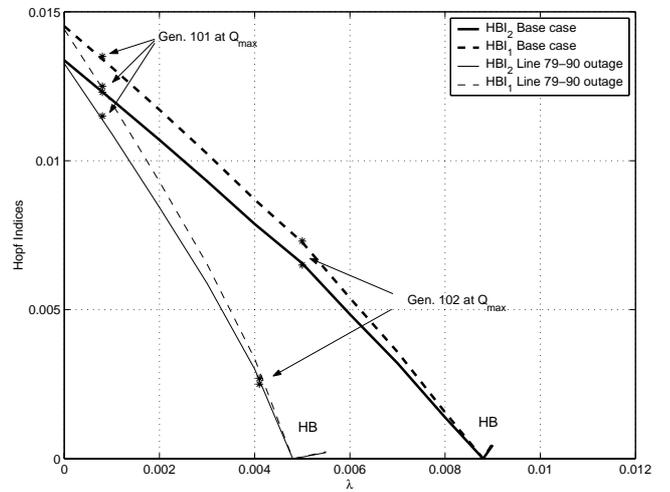


Fig. 17. Hopf bifurcation indices for the IEEE 50-machine system, Case I.

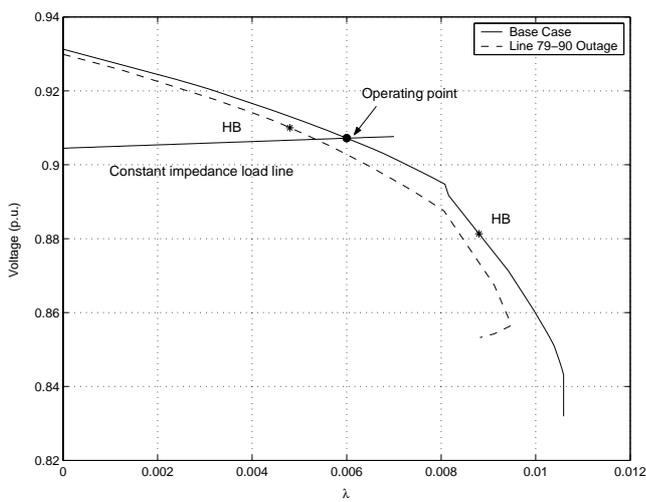


Fig. 15. P-V curve at bus 92 for the IEEE 50-machine system, Case I.

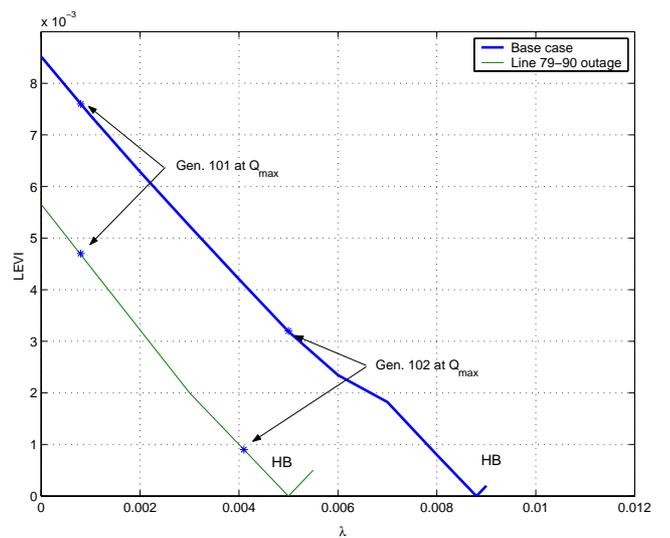


Fig. 18. Linearized eigenvalue index for the IEEE 50-machine system, Case I.

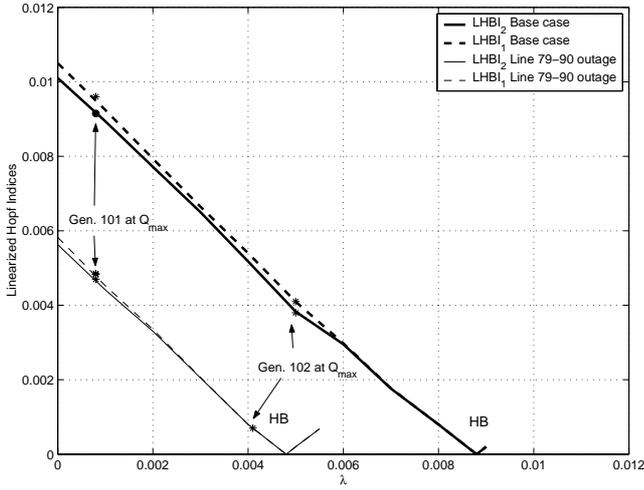


Fig. 19. Linearized Hopf bifurcation indices for the IEEE 50-machine system, Case I.

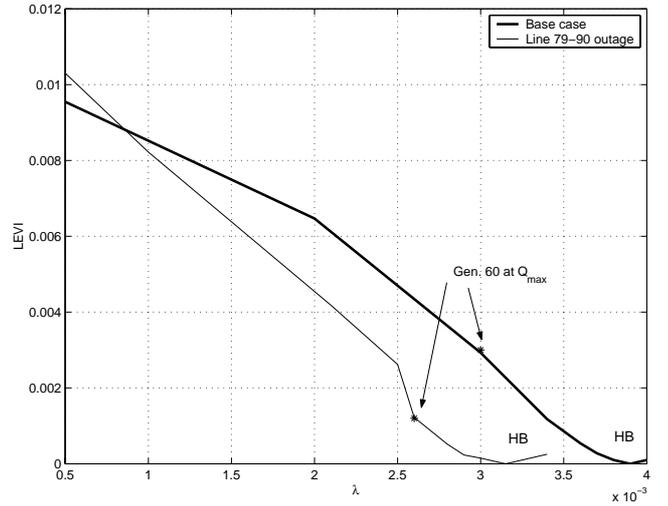


Fig. 22. Linearized eigenvalue index for the IEEE 50-machine system, Case II.

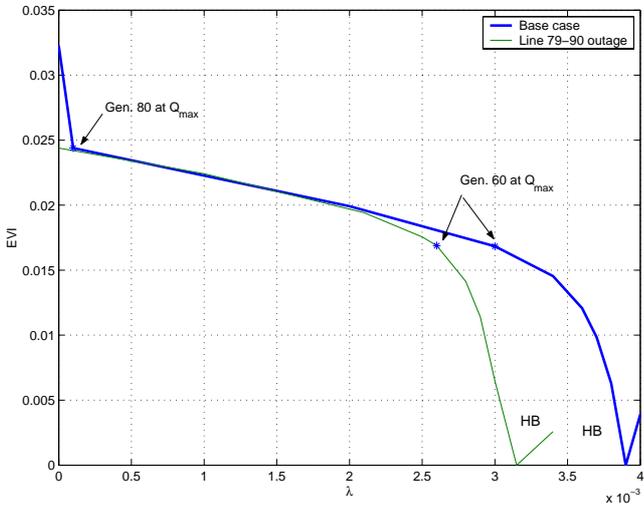


Fig. 20. Eigenvalue index for the IEEE 50-machine system, Case II.

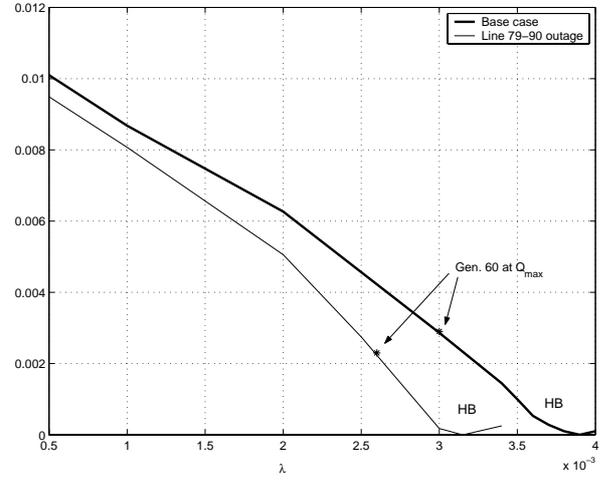


Fig. 23. Linearized Hopf bifurcation index for the IEEE 50-machine system, Case II.

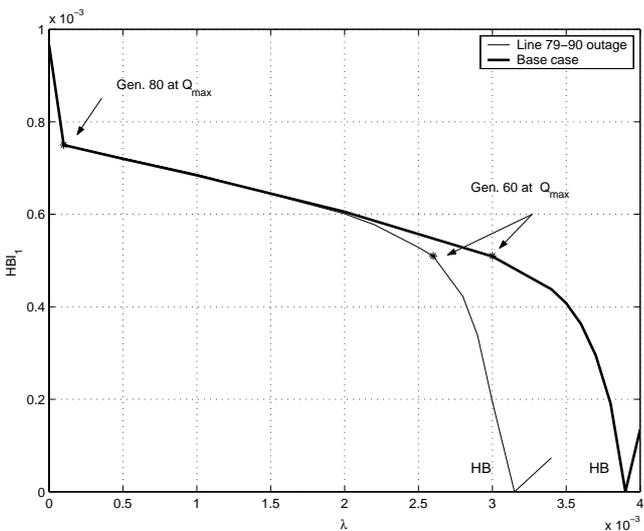


Fig. 21. Hopf bifurcation index for the IEEE 50-machine system, Case II.

$LHBI_1$ results. Observe the general nonlinear profile of the EVI , HBI_1 and $LEVI$ indices, which in this case is basically due to system modes other than the initial critical eigenvalue or singular value becoming critical as generator limits are encountered. Observe, however, that the $LHBI_1$ presents a slightly better profile than the other indices.

It is important to highlight the fact that, due to the differences on the types of simplified exciter models available in the commercial software packages used to obtain the results presented in this paper, as well as the availability or not, depending on the software package used, of the extended matrix information required to compute the HBI_2 and corresponding $LHBI_2$ indices, the latter could not be computed in this particular case.

B. Subsynchronous Resonance Example

Subsynchronous resonance (SSR) is a well-known problem of undamped oscillations that may occur when the transmis-




Fig. 24. Generator- ∞ bus system with compensated line.

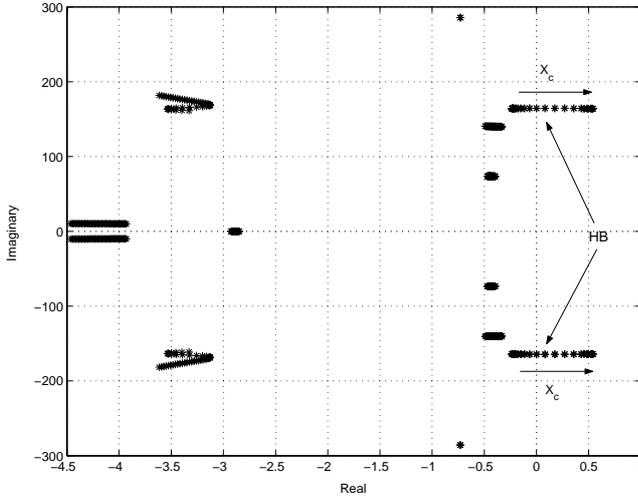


Fig. 25. Locus of the critical eigenvalue for the SSR example.

sion line to which the machine is connected is compensated by a series capacitor, as depicted in Fig. 24. In this case, the dynamics of the RLC circuit cannot be neglected, since the line presents two modes whose frequency can be roughly estimated as $\omega_b(1 \pm \sqrt{X_C/X_L})$, where ω_b is the base frequency in rad/sec. For typical values of the inductive and capacitive reactances, the lower of these two frequencies can be close to one of the mechanical oscillations of the generator shaft. Thus, beyond a certain value of the compensation level, the machine may experience a negative damping of one of the mechanical modes that results in dangerous stress to the shaft.

The Hopf bifurcation indices EVI and HBI_1 are used here to predict the SSR point, with respect to the capacitor compensation X_c , which in this case is the parameter λ . The system model used in this paper is identical to the one presented in [3] and [4]. Thus, a complex mode crosses the imaginary axis as λ increases, creating a Hopf bifurcation associated with a SSR problem, as shown in Fig. 25; observe that a pair of complex eigenvalues with a frequency of about 26 Hz cross the imaginary axis at $\lambda = X_c = 0.158$ p.u., which approximately corresponds to a 53 % compensation level. (It should be noted that Fig. 25 is somewhat similar to Fig. 2 in [4] for the X_c values of interest to this paper, i.e. the values of X_c near the Hopf bifurcation associated with the SSR problem, which is where the system first becomes unstable. As X_c is further increased, other bifurcations and larger changes in the frequency of the eigenvalues may be observed in the system, as discussed and depicted in [4].)

The EVI and $LEVI$, and HBI_1 and $LHBI_1$ are illustrated in Figs. 26 and 27, respectively. Notice the quasi-linear and smooth behavior of the $LHBI_1$, which can be used to predict the problematic compensation level and thus avoid the onset of oscillations. In this case, since the model used does

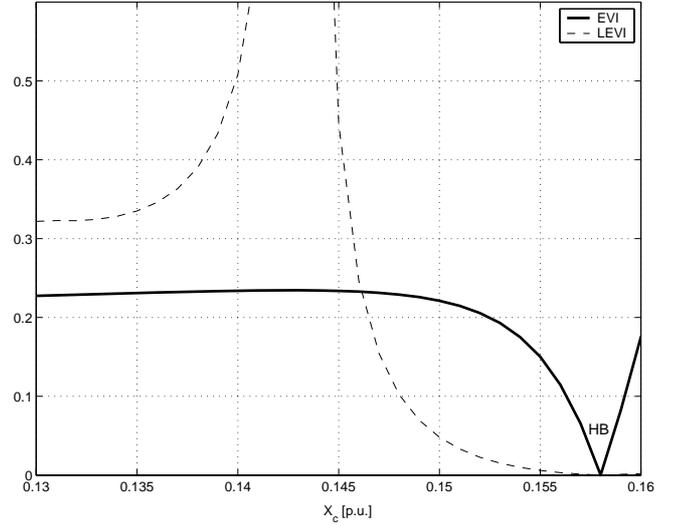


Fig. 26. Eigenvalue index and its linearization for the SSR example.

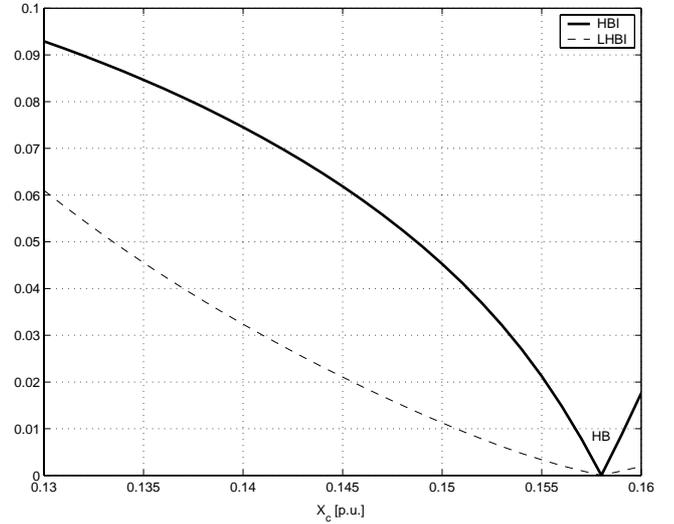


Fig. 27. Hopf bifurcation index and its linearization for the SSR example.

not include algebraic equations, there is no difference between HBI_1 and HBI_2 , and $LHBI_1$ and $LHBI_2$.

C. Discussion

Among all indices, the less expensive computationally is clearly EVI ; on the other hand, HBI_2 is computationally less demanding than HBI_1 , as shown in Table I, where the time savings of computing HBI_2 with respect to the computation of HBI_1 are presented. Observe that the savings increase with the size of the power system, as expected, since the calculation of the inverse of the matrix J_4 is not needed, exploiting the sparsity of the jacobian in the HBI_2 calculations. It is also important to highlight the fact that the computational cost of obtaining the minimum singular values needed for computing HBI_2 is not very significant, once the critical eigenvalue is determined, since a simple inverse iteration technique can be readily applied to the extended matrix J_m to determine this value in a few iterations. Furthermore, the

TABLE I
TIME SAVINGS OF COMPUTING HBI_2 WITH RESPECT TO HBI_1

System	Buses	Machines	% Time Savings
Three-bus	3	2	none
Two-area	11	4	4
IEEE 50-machine	145	50	20

numerical linearization of all these indices is not significant from the computational point of view, as it only requires simple operations with adjacent index values.

The calculation of the proposed indices on-line requires the state matrix A or the extended system matrix J , as well as the value of the critical eigenvalue μ . The information needed for the construction of these matrices are a fast power flow solution, along with the system topology update, models and data of machines and other controllers of interest. Typically, these system data, both static and dynamic, are available in modern control centers, and getting fast and multiple power flow solutions is not an issue nowadays. Once the matrices are setup, any efficient eigenvalue algorithm can be used to quickly compute μ . Thus, a reliable detection of HBs using these indices is certainly feasible.

As shown in the several examples discussed in this paper, EVI , HBI_1 or HBI_2 are adequate for detection of HBs, as they all show a smooth profile with respect to the varying parameter in all cases, with the EVI index presenting some computational advantages. However, these indices do not present a linear profile in all cases (e.g. 50-machine Case II, and SSR example), and hence are not always appropriate for making reliable predictions of the onset of HBs. Hence, based on the quasi-linear profile of the proposed linearized indices, particularly the $LHBI$ indices, in most cases, and given the fact that the additional computational costs are not excessive, especially for $LHBI_2$, one can reasonably argue that the $LHBI_2$ index appears to be the best option for a variety of practical power system applications.

The power system examples presented here, with different dynamic characteristics as well as varying size and complexity, resemble practical power systems. Hence, the application of the proposed indices to the on-line monitoring of a practical power system is shown here to be a feasible proposition. Furthermore, in practical systems, information of the value of β or the frequency of the problematic modes are typically known (e.g. WSCC inter-area modes; Ontario Hydro local modes); thus, by inserting the expected value of β in the state matrices, the HBI and $LHBI$ indices can be calculated without actually having to compute the critical eigenvalue, thus reducing the computational costs associated with determining the value of these indices.

In a real scenario, a power system faces varying operation conditions (e.g. load increase with different directions; line outages). Figure 28 illustrates possible profiles of Hopf bifurcation indices for various system conditions, i.e. base case and a line outage case with different load directions. In the case of a change in operating conditions, the proposed Hopf bifurcation indices follow a different profile. A possible

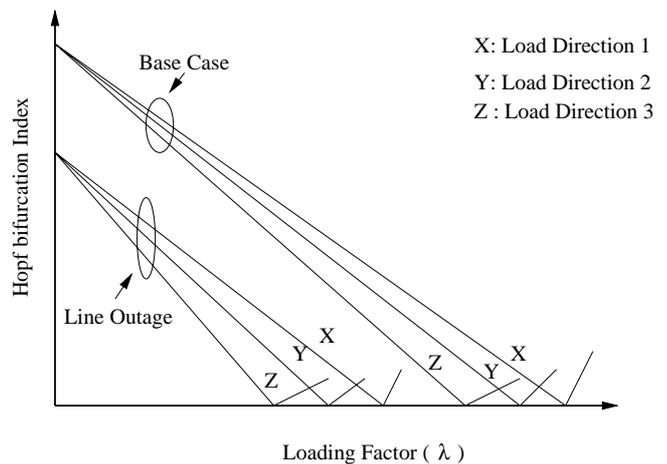


Fig. 28. Hopf bifurcation index for various operating conditions.

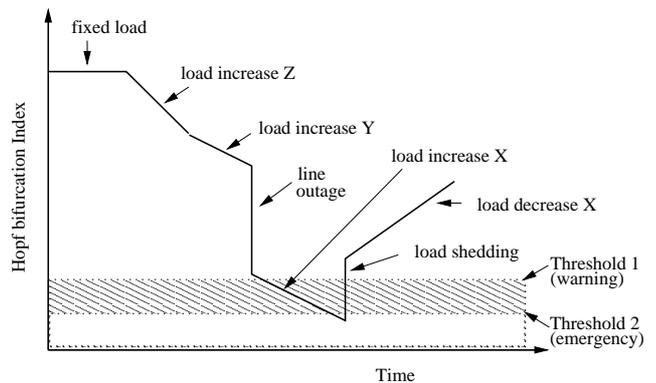


Fig. 29. Hopf bifurcation index as an on-line operating tool.

profile of the Hopf bifurcation indices as an operator would see it in real-time is depicted in Fig. 29. By monitoring the index on-line and making predictions based on linear extrapolations of the index, timely remedial measures such as load shedding can be implemented when the indices hit a given threshold value. The determination of adequate threshold values, however, is certainly not a simple task, as it requires multiple off-line simulations for a variety of system operating conditions, as well as a good operational knowledge of the system. Furthermore, observe that the linear extrapolations that would allow operators to somewhat adequately predict possible stability problems at a given operating condition, have to be continuously reassessed and weighed against the operators' knowledge of the system before taking any remedial emergency actions, given the ever changing network conditions. Thus, all these indices must be considered as additional, albeit important, tools on the operator's toolbox to help him/her make adequate operating decisions on-line.

V. CONCLUSIONS

This paper studies and proposes various indices to predict and detect proximity to the HB points in nonlinear systems, and hence the onset of oscillatory stability problems such as inter-area, local mode and subsynchronous resonance oscillations in power systems. It is shown that, of the proposed

indices, the $LHBI_2$ index presents certain advantages that make it suitable for on-line applications, as the smooth and quasi linear behavior of this index allows to reliably predict the onset of oscillatory problems in a variety of practical power system applications.

REFERENCES

- [1] H. G. Kwatny, A. K. Pasrija, and L. Y. Bahar, "Static bifurcation in electric power networks: Loss of steady-state stability and voltage collapse," *IEEE Trans. Circuits Systems*, vol. 33, 1986, pp. 981–991.
- [2] V. Ajjarapu and B. Lee, "Bifurcation Theory and its Application to Nonlinear Dynamical Phenomena in an Electrical Power System," *IEEE Trans. Power System*, vol. 7, no. 1, February 1992, pp. 424–431.
- [3] W. Zhu, R. R. Mohler, R. Spee, W. A. Mittelstadt, and D. Maratukulam, "Hopf bifurcations in a SMIB Power System with SSR," *IEEE Trans. Power Systems*, vol. 11, no. 3, 1996, pp. 1579–1584.
- [4] Y. Mitani, K. Tsuji, M. Varghese, F. F. Wu, and P. Varaiya, "Bifurcations Associated with Sub-Synchronous Resonance," *IEEE Trans. Power Systems*, vol. 13, no. 1, 1998, pp. 139–144.
- [5] N. Mithulananthan, C. A. Cañizares, and J. Reeve. "Hopf Bifurcation Control in Power System Using Power System Stabilizers and Static Var Compensators". In *Proc. of NAPS'99*, pp. 155–163, San Luis Obispo, California, October 1999.
- [6] J. Li and V. Venkatasubramanian. "Study of Hopf bifurcation in a Simple Power System Model". In *Proc. of the 39th Conference on Decision and Control*, pp. 3075–3079, Sydney, December 2000.
- [7] V. Venkatasubramanian, H. Schattler, and J. Zaborszky, "Dynamics of Large Constrained Nonlinear System-A Taxonomy Theory," *Proc. IEEE: Special Issue on Nonlinear Phenomena in Power Systems*, vol. 83, no. 11, November 1995, pp. 1530–1561.
- [8] C. A. Cañizares, F. L. Alvarado, C. L. DeMarco, I. Dobson, and W. F. Long, "Point of Collapse Method Applied to AC/DC Power Systems," *IEEE Trans. Power System*, vol. 7, no. 2, May 1992, pp. 673–683.
- [9] C. Cañizares, ed., "Voltage Stability Assessment: Concepts, Practices and Tools," Special Publication, IEEE-PES Power System Stability Subcommittee, available at <http://www.power.uwaterloo.ca>, August 2002.
- [10] E. H. Abed and P. P. Varaiya, "Nonlinear Oscillations in Power Systems," *International Journal of Electric Power and Energy Systems*, vol. 6, 1984, pp. 37–43.
- [11] W. D. Rosehart and C. A. Cañizares, "Bifurcation analysis of various power system models," *International Journal of Electrical Power and Energy Systems*, vol. 12, 1999, pp. 171–182.
- [12] N. Mithulananthan and S. C. Srivastava. "Investigation of a Voltage Collapse Incident in Sri Lankan Power System Network". In *Proc. of EMPD'98*, pp. 47–52, Singapore, March 1998.
- [13] C. Alsberg, "WSCC issues Preliminary Report on August Power Outage: PRESS RELEASE," technical report, WSCC, Available at <http://www.wsc.com/augdist.htm>, September 1996.
- [14] C. D. Vournas, M. A. Pai, and P. W. Sauer, "The Effect of Automatic Voltage Regulation on the Bifurcation Evolution in Power Systems," *IEEE Trans. Power System*, vol. 11, no. 4, 1996, pp. 37–43.
- [15] N. Mithulananthan, C. A. Cañizares, J. Reeve, and G. J. Rogers, "Comparison of PSS, SVC and STATCOM Controllers for Damping Power System Oscillations," accepted for publication in *IEEE Trans. Power Systems*, October 2002.
- [16] S. K. Joshi and S. C. Srivastava. "Estimation of Closest Hopf Bifurcation in Electric Power System". In *12th Power System Computational Conference*, August 1996.
- [17] R. Seydel, *Practical Bifurcation and Stability Analysis: From Equilibrium to Chaos*. Second Edition, Springer-Verlag, New York, 1994.
- [18] T. Kim and E. H. Abed, "Closed-Loop Monitoring Systems for Detecting Impending Instability," *IEEE Trans. Circuits and Systems*, vol. 47, no. 10, October 2000, pp. 1479–1493.
- [19] P. Kundur, *Power System Stability and Control*. McGraw Hill, New York, 1994.
- [20] A. Berizzi, P. Finazzi, D. Dosi, P. Marannino, and S. Cors. "First and Second order Methods for Voltage Collapse Assessment and Security Enhancement". In *Proc. of IEEE/PES Winter Meeting*, New York, February 1997.
- [21] *Power System Toolbox Version 2.0: Load Flow Tutorial and Functions*. Cherry Tree Scientific Software, RR-5 Colborne, Ontario K0K 1S0, 1991-1999.

- [22] V. Vittal, Chairman, "Transient Stability Test System for Direct Stability Methods," *IEEE Transaction on Power Systems*, vol. 7, no. 1, February 1992, pp. 37–42.

PLACE
PHOTO
HERE

Claudio A. Cañizares (SM'00) received in April 1984 the Electrical Engineer diploma from the Escuela Politécnica Nacional (EPN), Quito, Ecuador, where he held various teaching and administrative positions from 1983 to 1993. His M.Sc. (1988) and Ph.D. (1991) degrees in Electrical Engineering are from the University of Wisconsin–Madison. Dr. Cañizares is currently a Professor and the Deputy Chair of the E&CE Department, University of Waterloo, and his research activities concentrate in the study of stability, control, modeling and computa-

tional issues in power systems.

PLACE
PHOTO
HERE

Nadarajah Mithulananthan (M'02) was born in Sri Lanka. He received his Ph.D. from University of Waterloo in Electrical and Computer engineering in 2002. His B.Sc. (Eng.) and M.Eng. degrees are from the University of Peradeniya, Sri Lanka, and the Asian Institute of Technology, Bangkok, Thailand, in May 1993 and August 1997, respectively. He has worked as an Electrical Engineer at the Generation Planning Branch of the Ceylon Electricity Board, and as a Researcher at Chulalongkorn University, Bangkok, Thailand. Dr. Mithulananthan is currently

an Assistant Professor at the Asian Institute of Technology and his research interests are voltage stability and oscillation studies on practical power systems and applications of FACTS controllers in transmission and distribution systems.

PLACE
PHOTO
HERE

Federico Milano (S'02) received in March 1999 the Electrical Engineering degree from the University of Genova, Italy. Since March 2000, he has been in the Ph.D. program at the Electrical Engineering Department, University of Genova, in the field of power system analysis and control. From September 2001 to December 2002 he worked at the Electrical & Computer Engineering Department of the University of Waterloo as a Visiting Scholar. His research interests are voltage stability and electricity market.

PLACE
PHOTO
HERE

John Reeve (F'81) received the B.Sc., M.Sc., Ph.D. and D.Sc. degrees from the University of Manchester (UMIST). After employment in the development of protective relays for English Electric, Stafford, between 1958 and 1961, he was a lecturer at UMIST until joining the University of Waterloo in 1967, where he is currently an Adjunct Professor in the Department of Electrical & Computer Engineering. He was a project manager at EPRI, 1980–81, and was with IREQ, 1989–1990. His research interests since 1961 have been HVDC transmission and high power electronics. He is the President of John Reeve Consultants Limited. Dr. Reeve was chair of the IEEE DC Transmission Subcommittee for 8 years, and is a member of several IEEE and CIGRE Committees on dc transmission and FACTS. He was awarded the IEEE Uno Lamm High Voltage Direct Current Award in 1996.